

## RAPORT EFICIENTA SOLARA


### ***SELECTIVE SYSTEM PLUS 200 + LUNA 3 SYSTEM HT 1.330 MP SOLAR PLUS SP2 + PREMIUM HT 33-200***

2 x SB25

Total Gross Surface Area: 5,03 m<sup>2</sup>

Azimuth: 0°

Incl: 45°

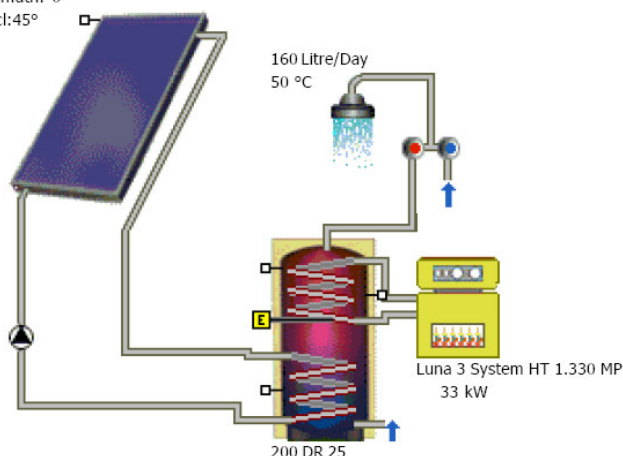

#### System Components

##### Collector Loop

Manufacturer:	Baxi
Type:	SB25
Number:	2,00
Total Gross Surface Area:	5,032 m <sup>2</sup>
Total Active Solar Surface Area:	4,62 m <sup>2</sup>
Tilt Angle:	45 °
Azimuth:	0 °

##### Bivalent (Twin Coil) DHW Tank incl. Heating Element (2.5 kW)

Manufacturer:	Baxi
Type:	200 DR 25
Volume:	200 l

##### Auxiliary Heating

Manufacturer:	Baxi
Type:	Luna 3 System HT 1.330 MP
Nominal Output:	33 kW

#### Basic Data

##### Climate File

Location:	Bucuresti
Climate Data Record:	"Bucuresti"
Total Annual Global Radiation:	1324.32 kWh
Latitude:	44.5 °
Longitude:	-26.22 °

##### Domestic Hot Water

Average Daily Consumption:	160 l
Desired Temperature:	50 °C
Load Profile:	Detached House (evening max)
Cold Water Temperature:	February: 8 °C / August: 12 °C


#### Results of Annual Simulation

Installed Collector Power:	3,52 kW	
Installed Gross Solar Surface Area:	5,032 m <sup>2</sup>	
Collector Surface Area Irradiation:	6,65 MWh	1,440.12 kWh/m <sup>2</sup>
Energy Produced by Collectors:	2,509.35 kWh	543.15 kWh/m <sup>2</sup>
Energy Produced by Collector Loop:	2,050.77 kWh	443.89 kWh/m <sup>2</sup>


DHW Heating Energy Supply:	2719.95 kWh
Solar Contribution to DHW:	2050.77 kWh
Energy from Auxiliary Heating:	1129.18 kWh

Natural Gas (H) Savings:	243.2 m <sup>3</sup>
CO <sub>2</sub> Emissions Avoided:	514.55 kg
DHW Solar Fraction:	64.5 %
Fractional Energy Savings (EN 12976):	64.5 %
System Efficiency:	30.8 %

#### Solar Energy Consumption as Percentage of Total Consumption

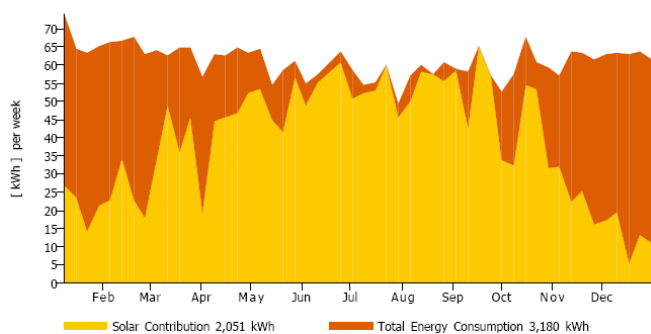

#### Daily Maximum Collector Temperature

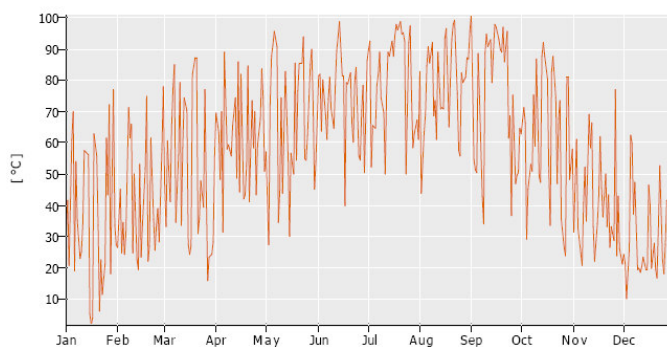

Aceste calcule au fost efectuate cu ajutorul programului T-SOL Pro 4.5 - software de simulare pentru sisteme termice de încălzire ce folosesc energia solara. Rezultatele sunt determinate in baza unui model matematic de calcul. Randamentul real se poate abate de la aceste valori, datorita fluctuatilor climatice, modului de exploatare sau altori factori externi. Schema de mai sus nu reprezinta si nu poate înlocui un proiect tehnic de executie al sistemului solar.